



Goodwyn Mills Cawood
11 North Water Street
Suite 15250
Mobile, Alabama 36602
T 251.460.4006
F 251.460.4423

FASCIMILE TRANSMITTAL COVER SHEET

DATE: April 26, 2024
TO: Doris Furr
FROM: Planholder
PROJECT: RENOVATIONS TO FREDERICKA G. EVANS CULTURAL CENTER
For BISHOP STATE COMMUNITY COLLEGE
GMC PROJECT NO. AMOB240022
RE: ADDENDUM NO. 3 AND ACKNOWLEDGEMENT OF RECEIPT OF ADDENDUM NO. 3

ACKNOWLEDGEMENT OF RECEIPT:

PLEASE PRINT RECIPIENT'S NAME, FIRM, AND DATE RECEIVED.

THEN FAX BACK TO (251) 460-4423 or EMAIL doris.furr@gmcnetwork.com
FOR OUR RECORDS AND TO ACKNOWLEDGE YOUR RECEIPT OF THIS ADDENDUM.

NAME (PLEASE PRINT)

FIRM (PLEASE PRINT)

DATE RECEIVED (PLEASE PRINT)

ADDENDUM NUMBER 3

April 26, 2024

PROJECT:

**RENOVATIONS TO FREDERICKA G. EVANS CULTURAL CENTER
BISHOP STATE COMMUNIT COLLEGE
GMC PROJECT NO. AMOB240022**

AD3-1 CLARIFICATIONS / RFI RESPONSES / ADDITIONS / ETC.:

- A. Bidders shall acknowledge receipt of the Addendum in writing, as provided on the Acknowledgment Receipt.
- B. Note: Keep the two existing bottle fillers on the back Corridor 101. They will not be demolished or replaced as noted on the drawings in Addendum No. 2.
- C. How thick is the slab that is being sawcut?
RESPONSE: *"I don't think anyone knows because we don't have any original construction drawings. But, I'd recommend that we have the contractors assume 4"-5" for pricing purposes. I'd be shocked if it turned out to be thicker than that."* -James Russell
- D. See D-E1.01 revisions in regards to the Fire Alarm Panel.

AD3-2 ISSUED SPECIFICATIONS:

- A. None.

AD3-3 ISSUED DRAWINGS:

- A. Replace sheet D-E1.01 – FIRST FLOOR ELECTRICAL DEMOLITION PLAN in it's entirety.

AD3-4 ATTACHMENTS:


- A. D-E1.01 – FIRST FLOOR ELECTRICAL DEMOLITION PLAN
- B. Acknowledgement of Receipt.

END OF ADDENDUM

PREPARED BY

Goodwyn Mills Cawood, LLC
11 North Water Street, Suite 15250
Mobile, Alabama 36602
T 251.460.4006
F 251.460.4223



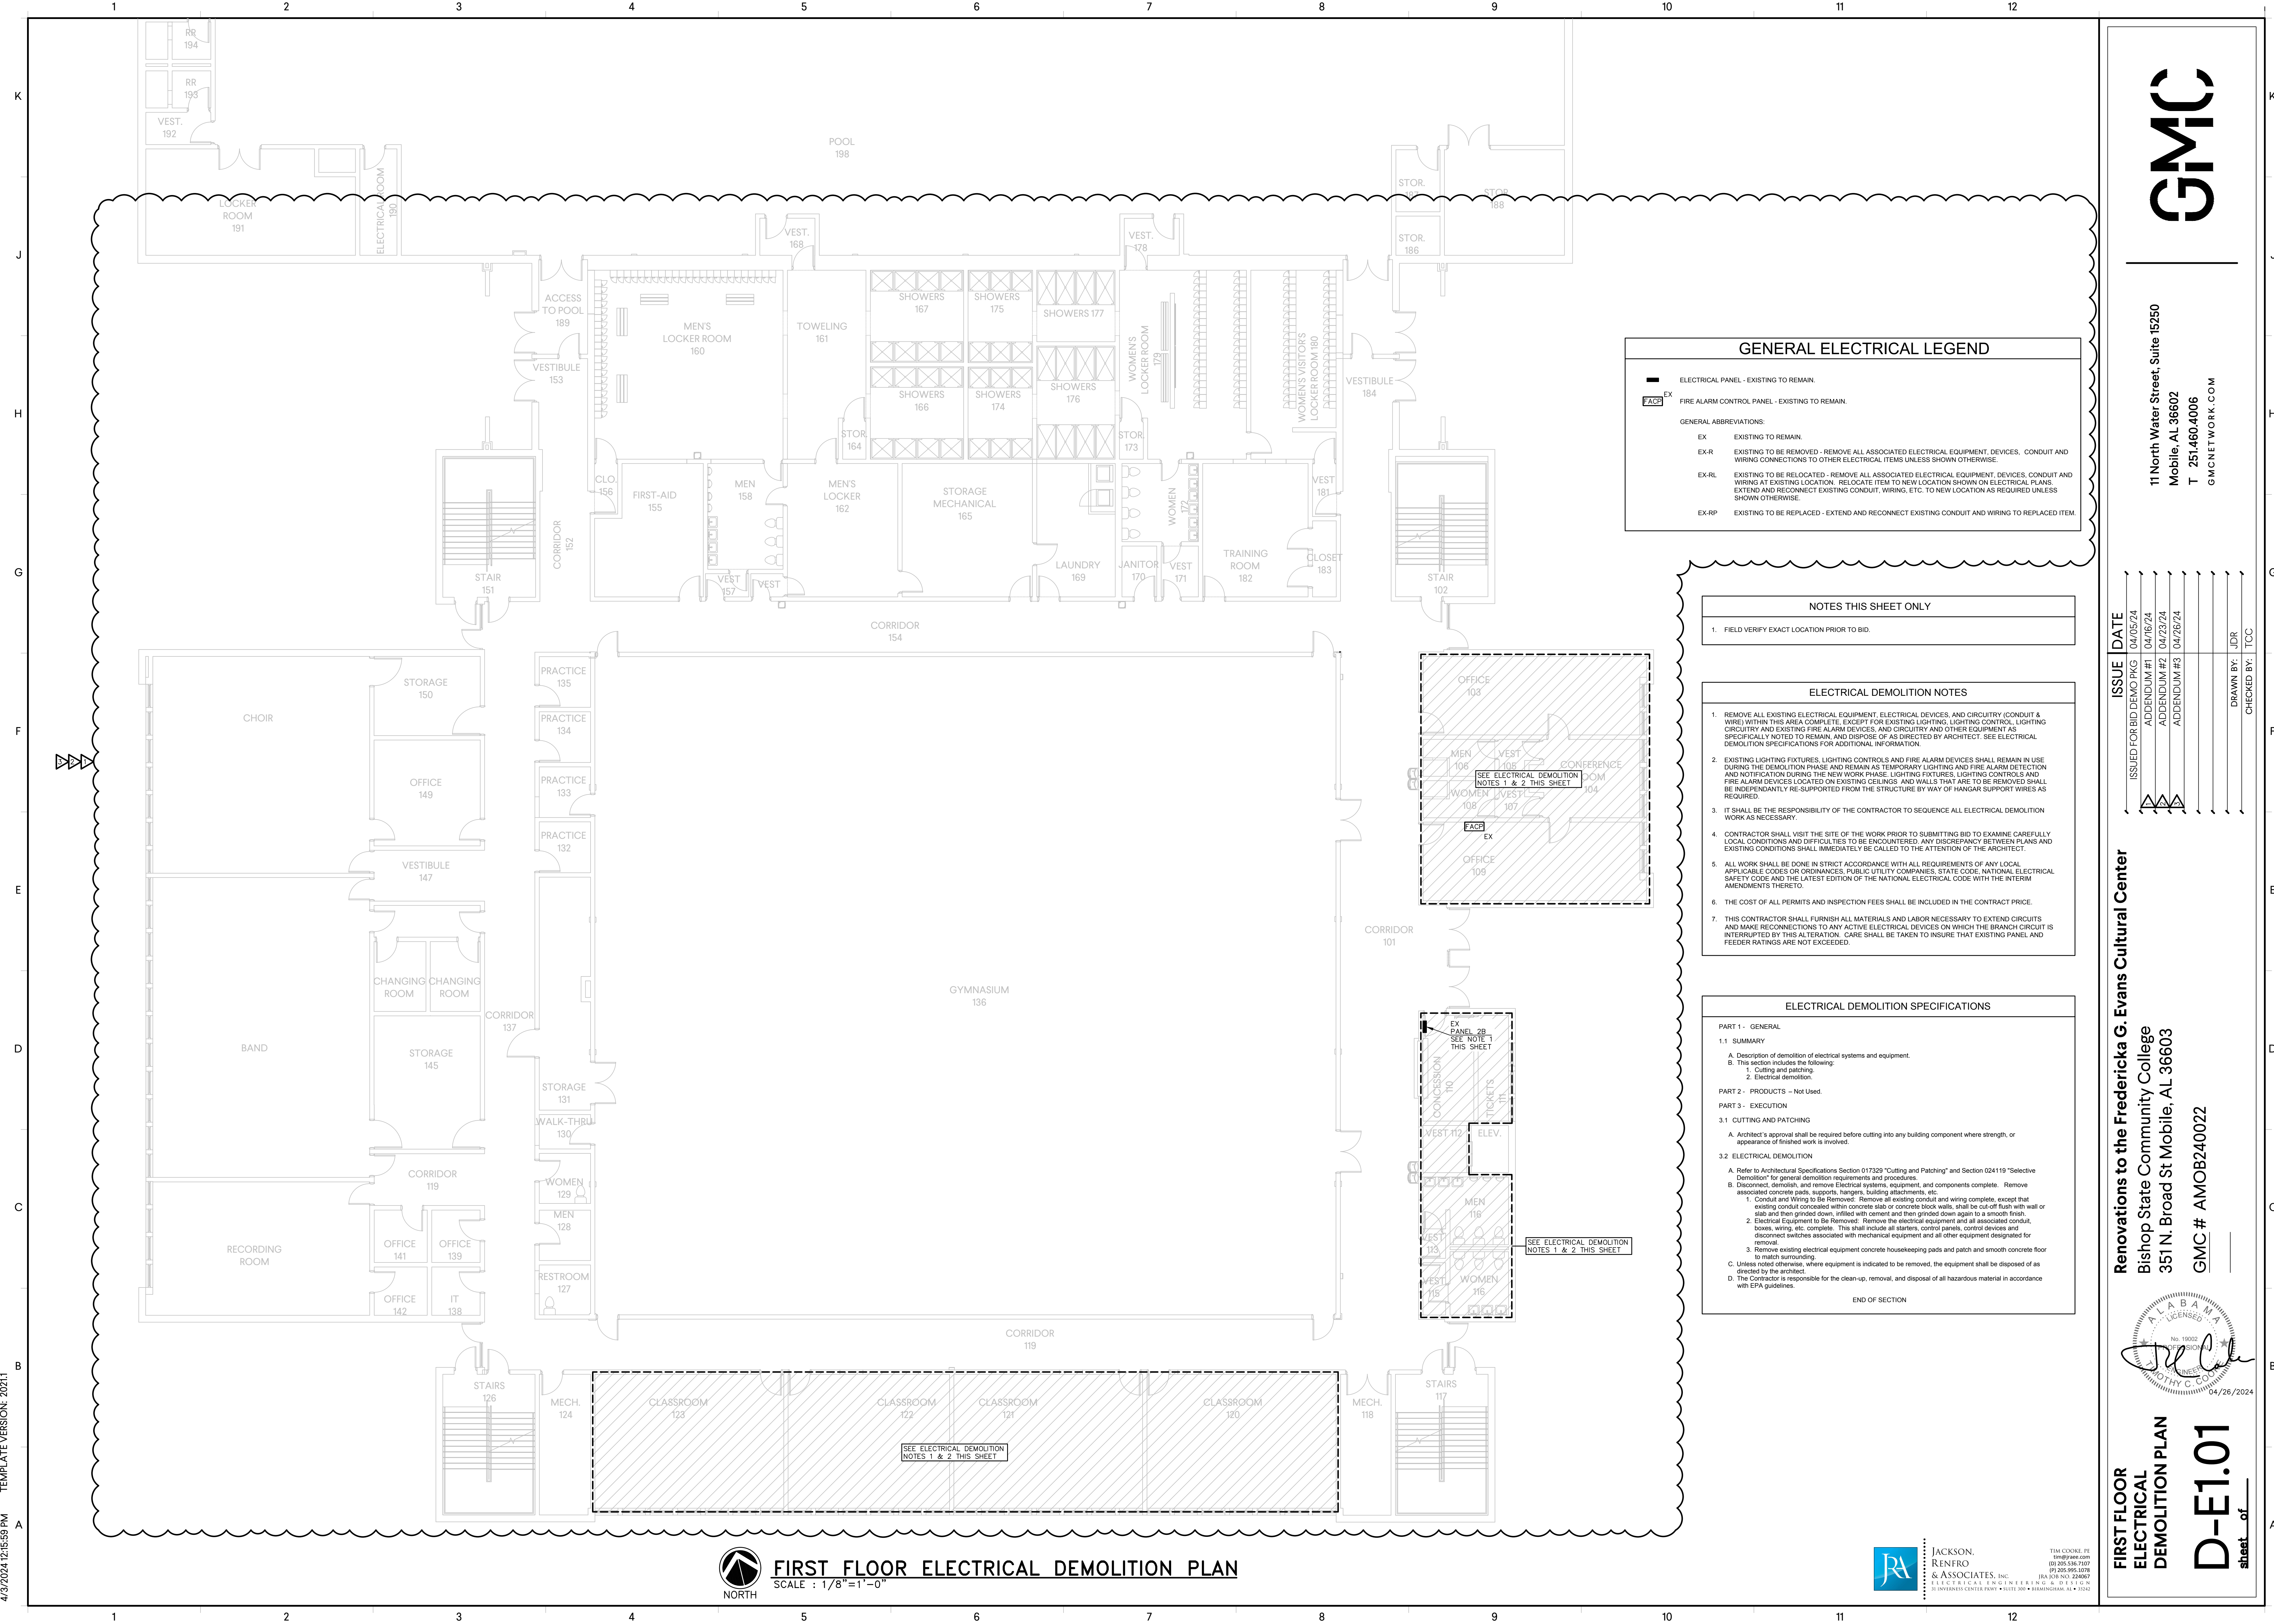

GENERAL ELECTRICAL LEGEND

ELECTRICAL PANEL - EXISTING TO REMAIN.
 EX FIRE ALARM CONTROL PANEL - EXISTING TO REMAIN.

GENERAL ABBREVIATIONS:

EX EXISTING TO REMAIN.
 EX-R EXISTING TO BE REMOVED - REMOVE ALL ASSOCIATED ELECTRICAL EQUIPMENT, DEVICES, CONDUIT AND WIRING CONNECTIONS TO OTHER ELECTRICAL ITEMS UNLESS SHOWN OTHERWISE.
 EX-RL EXISTING TO BE RELOCATED - REMOVE ALL ASSOCIATED ELECTRICAL EQUIPMENT, DEVICES, CONDUIT AND WIRING AT EXISTING LOCATION - RELOCATE ITEM TO NEW LOCATION SHOWN ON ELECTRICAL PLANS. EXTEND AND RECONNECT EXISTING CONDUIT, WIRING, ETC. TO NEW LOCATION AS REQUIRED UNLESS SHOWN OTHERWISE.
 EX-RP EXISTING TO BE REPLACED - EXTEND AND RECONNECT EXISTING CONDUIT AND WIRING TO REPLACED ITEM.

NOTES THIS SHEET ONLY

- FIELD VERIFY EXACT LOCATION PRIOR TO BID.

ELECTRICAL DEMOLITION NOTES

- REMOVE ALL EXISTING ELECTRICAL EQUIPMENT, ELECTRICAL DEVICES, AND CIRCUITRY (CONDUIT & WIRES) WITHIN THIS AREA COMPLETE. EXCEPT FOR EXISTING LIGHTING, LIGHTING CONTROL, LIGHTING CIRCUITRY AND EXISTING FIRE ALARM DEVICES, AND CIRCUITRY AND OTHER EQUIPMENT AS SPECIFICALLY NOTED TO REMAIN, AND DISPOSE OF AS DIRECTED BY ARCHITECT. SEE ELECTRICAL DEMOLITION SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- EXISTING LIGHTING FIXTURES, LIGHTING CONTROLS AND FIRE ALARM DEVICES SHALL REMAIN IN USE DURING THE DEMOLITION PHASE AND REMAIN AS TEMPORARY LIGHTING AND FIRE ALARM DETECTION AND NOTIFICATION DURING THE NEW WORK PHASE. LIGHTING FIXTURES, LIGHTING CONTROLS AND FIRE ALARM DEVICES LOCATED ON EXISTING CEILING, AND WALLS THAT ARE TO BE REMOVED SHALL BE INDEPENDENTLY RE-SUPPORTED FROM THE STRUCTURE BY WAY OF HANGAR SUPPORT WIRES AS REQUIRED.
- IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO SEQUENCE ALL ELECTRICAL DEMOLITION WORK AS NECESSARY.
- CONTRACTOR SHALL VISIT THE SITE OF THE WORK PRIOR TO SUBMITTING BID TO EXAMINE CAREFULLY LOCAL CONDITIONS AND DIFFICULTIES TO BE ENCOUNTERED. ANY DISCREPANCY BETWEEN PLANS AND EXISTING CONDITIONS SHALL IMMEDIATELY BE CALLED TO THE ATTENTION OF THE ARCHITECT.
- ALL WORK SHALL BE DONE IN STRICT ACCORDANCE WITH ALL REQUIREMENTS OF ANY LOCAL APPLICABLE CODES OR ORDINANCES, PUBLIC UTILITY COMPANIES, STATE CODE, NATIONAL ELECTRICAL SAFETY CODE AND THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE WITH THE INTERIM AMENDMENTS THERE TO.
- THE COST OF ALL PERMITS AND INSPECTION FEES SHALL BE INCLUDED IN THE CONTRACT PRICE.
- THIS CONTRACTOR SHALL FURNISH ALL MATERIALS AND LABOR NECESSARY TO EXTEND CIRCUITS AND MAKE RECONNECTIONS TO ANY ACTIVE ELECTRICAL DEVICES ON WHICH THE BRANCH CIRCUIT IS INTERRUPTED BY THIS ALTERATION. CARE SHALL BE TAKEN TO INSURE THAT EXISTING PANELS AND FEEDER RATINGS ARE NOT EXCEEDED.

ELECTRICAL DEMOLITION SPECIFICATIONS

PART 1 - GENERAL

1.1 SUMMARY

A. Description of demolition of electrical systems and equipment.
 B. This section includes the following:
 1. Cutting and patching.
 2. Electrical demolition.

PART 2 - PRODUCTS - Not Used

PART 3 - EXECUTION

3.1 CUTTING AND PATCHING

A. Architect's approval shall be required before cutting into any building component where strength, or appearance of finished work is involved.

3.2 ELECTRICAL DEMOLITION

A. Refer to Architectural Specifications Section 017329 "Cutting and Patching" and Section 024119 "Selective Demolition" for general demolition requirements and procedures.
 B. Disconnect, demish, and remove Electrical systems, equipment, and components complete. Remove associated concrete pads, supports, hangers, building attachments, etc.
 1. Conduit and Wiring to Be Removed: Remove all existing conduit and wiring complete, except that existing conduit concealed within concrete slab or concrete block walls, shall be cut-off flush with wall or slab and then ground down, filled with cement and then grinded down again to a smooth finish.
 2. Electrical Equipment to Be Removed: Remove the electrical equipment and all associated conduit, boxes, wiring, etc. complete. This shall include all starters, control panels, control devices and disconnect switches associated with mechanical equipment and all other equipment designated for removal.
 3. Remove existing electrical equipment concrete housekeeping pads and patch and smooth concrete floor to match surrounding.
 C. Unless noted otherwise, where equipment is indicated to be removed, the equipment shall be disposed of as directed by the architect.
 D. The Contractor is responsible for the clean-up, removal, and disposal of all hazardous material in accordance with EPA guidelines.

END OF SECTION


GMC

11 North Water Street, Suite 15250
 Mobile, AL 36602
 T 251.460.4006
 GMCNETWORK.COM

ISSUE	DATE
ISSUED FOR BID DEMO PKG	04/05/24
ADDENDUM #1	04/16/24
ADDENDUM #2	04/23/24
ADDENDUM #3	04/26/24

DRAWN BY: JDR
 CHECKED BY: TCC

Renovations to the Fredericka G. Evans Cultural Center
 Bishop State Community College
 351 N. Broad St Mobile, AL 36603
 GMC# AMOB240022

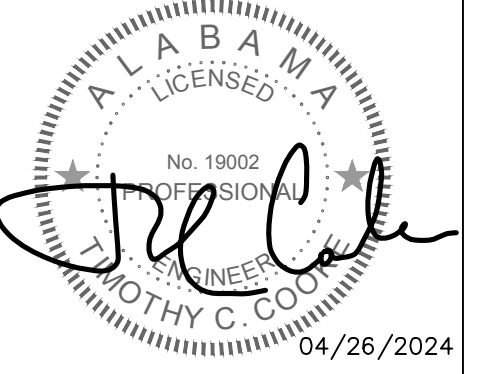

FIRST FLOOR ELECTRICAL DEMOLITION PLAN
D-E1.01
 sheet of

FIRST FLOOR ELECTRICAL DEMOLITION PLAN
 SCALE : 1/8"=1'-0"

JACKSON RENFRO & ASSOCIATES, INC.
 ELECTRICAL ENGINEERING & DESIGN
 10000 CENTRE HWY • SUITE 100 • HOUSTON, AL • 35882

TIM COOKE, PE
 tim@jraee.com
 (252) 996-7107
 (919) 995-1078
 (704) 995-0887
 JRAE00000120087

4/3/2024 12:45:59 PM TEMPLATE VERSION: 20211